




SECTION "A-A"
NO SCALE

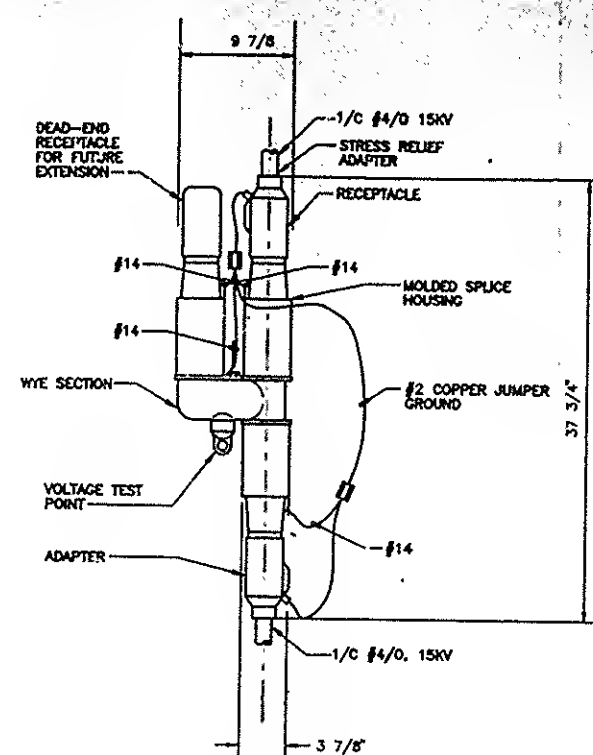

15KV-WYE SPLICE
(TYPICAL)
NO SCALE

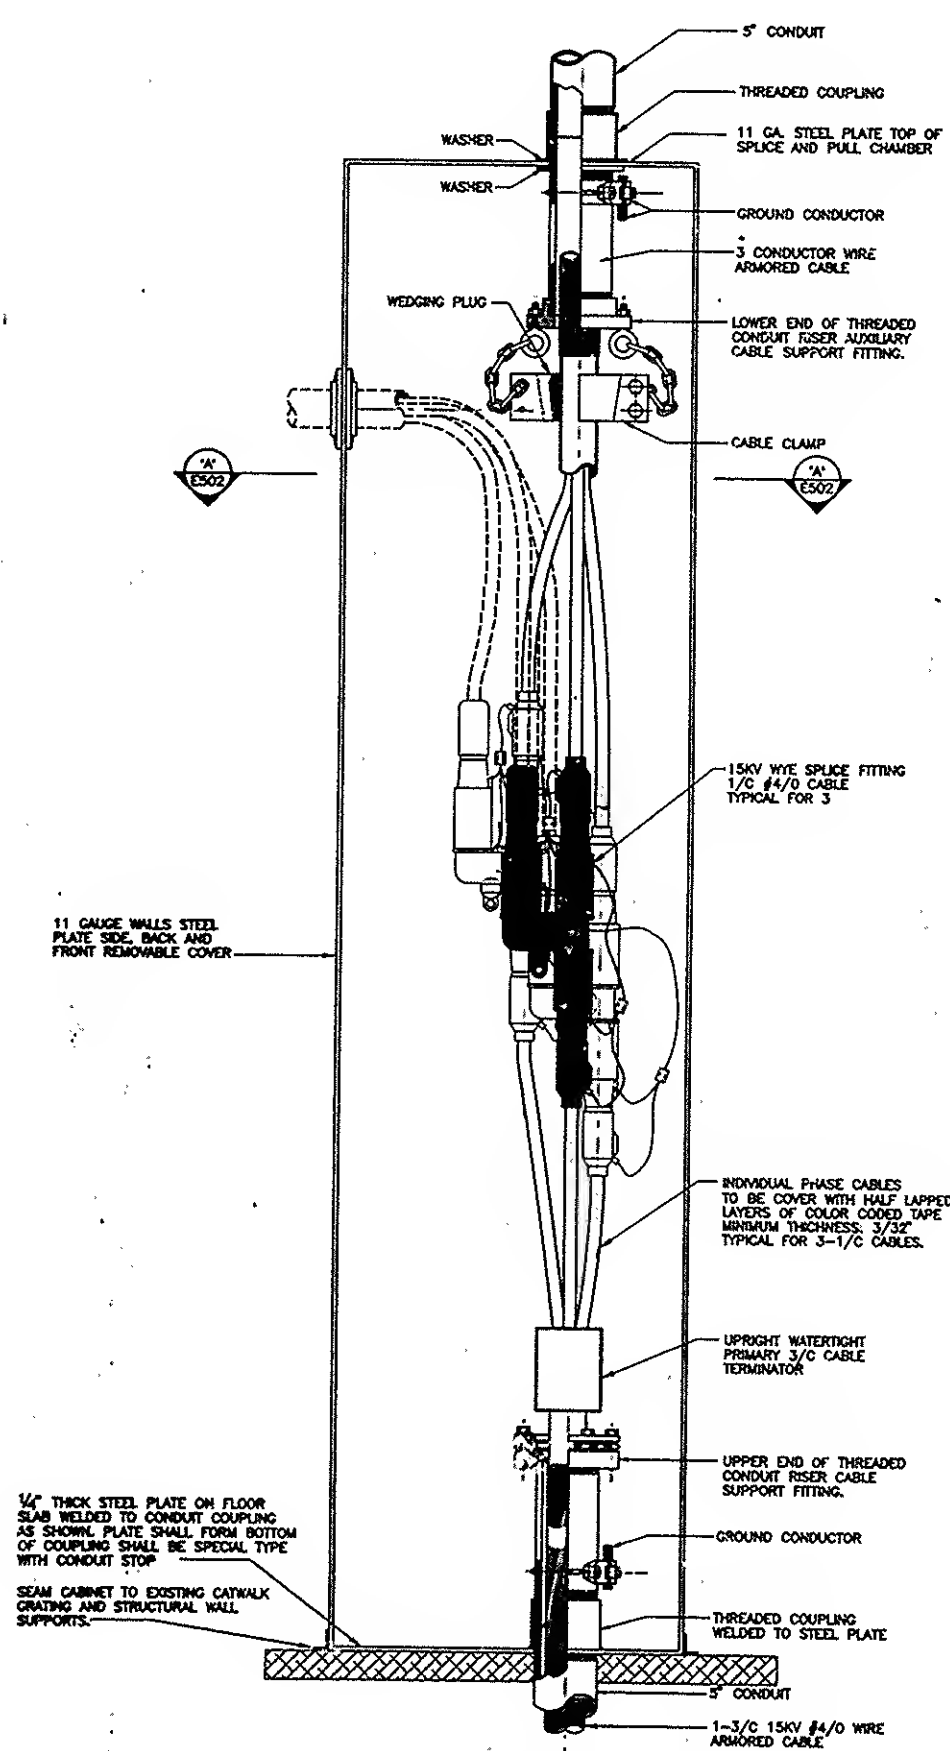

TYPICAL INSTALLATION DETAIL OF
15KV ARMORED CABLE SUPPORT
SPLICE AND PULL CABINET
NO SCALE

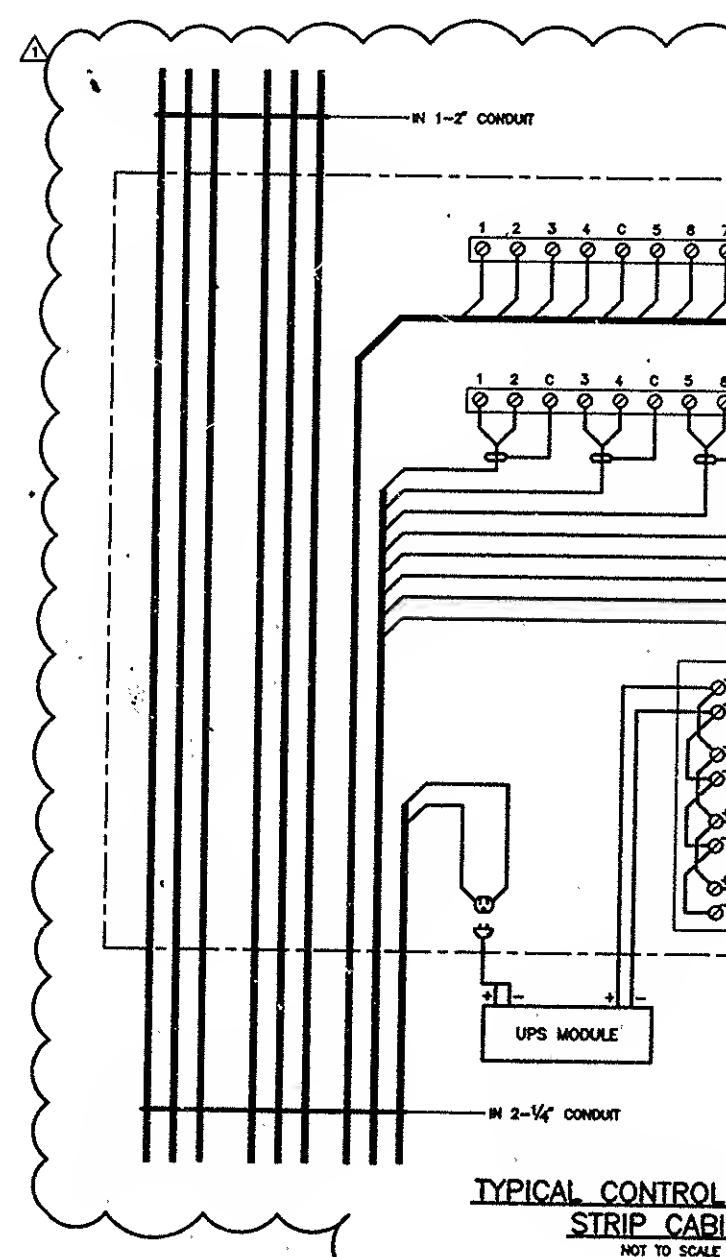

TYPICAL CONTROL
STRIP CABLE
NOT TO SCALE

- NOTES:
1. FOR NUMBER AND SIZE FOR CONDUIT SEE DRAWING DETAIL ET-02.
 2. UPS MODULE SHALL BE IDENTICAL TO OUTPUT 120VAC.
 3. UPS INSTALLATION SHALL INCLUDE WITH SLIDE RAILS OR BRACKETS A WALL MOUNTED SHELF, MOUNT UP STRIP CABINET AND CONNECTED TO IN THE STRIP CABINET.